



VENTS - manufacture of ventilation and air conditioning systems



Vents 100 MA
Maximum capacity - 98 m³/h.


Technical parameters

Parameter	Value	Unit
Voltage	220-240	V
Frequency	50	Hz
Power	18	W
Air capacity	98	m ³ /h
	57,722	CFM
	27,244	l/s
	0,02724	m ³ /s
	1636,6	l/m
Current	0.085	A
RPM	2300	min ⁻¹
Sound pressure level at 3 m	34	[dBA]
Weight	0.65	kg
Protection rating	IP 24	class
Spigot size	100	mm


Ташев-Галвинг ООД
www.tashev-galving.com

Wiring


Wiring diagram for the fans equipped with a built-in switch

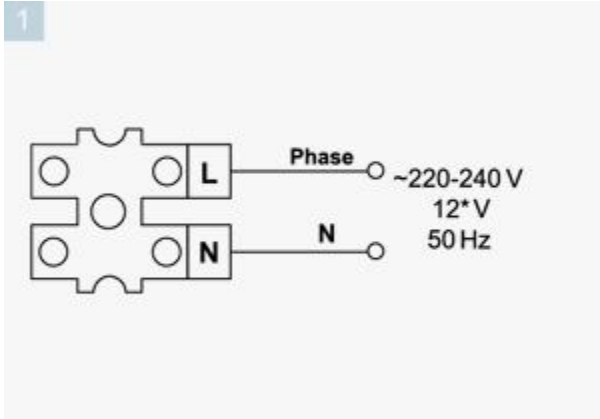


Wiring diagram for the fans equipped with a timer / timer, humidity sensor and a built-in switch

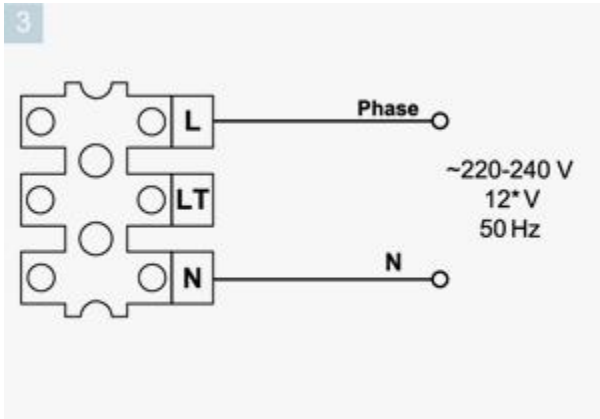

Wiring diagram for the fans with a light lamp. Separate activation of the fan and the built-in lamp.

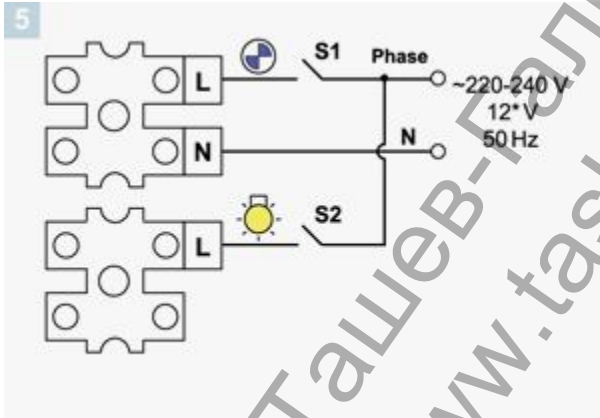


Wiring diagram for the fans with an light lamp and grounding. Separate activation of the fan and the built-in lamp.

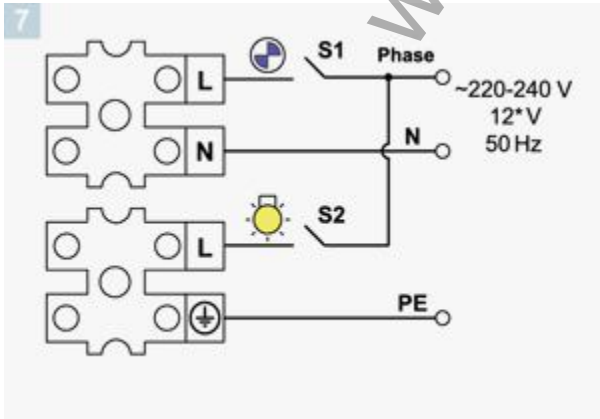


Wiring diagram for the fans with grounding


Wiring diagram for the fans without built-in switch

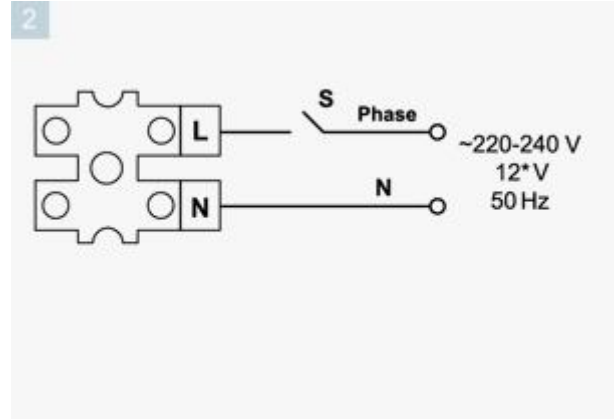


Wiring diagram for the fans equipped with a timer / timer with a humidity sensor without built-in switch

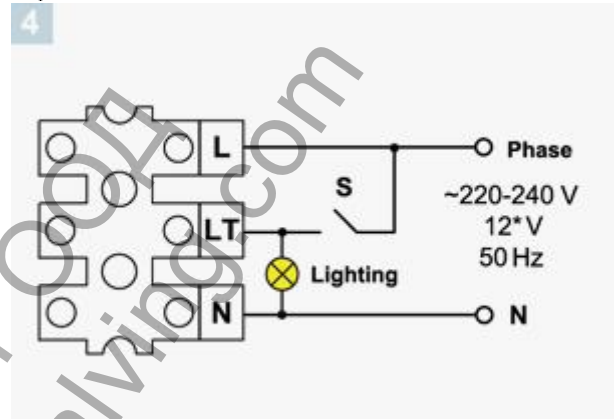


Wiring diagram for the fans with a light lamp. Parallel activation of the fan and the built-in lamp.

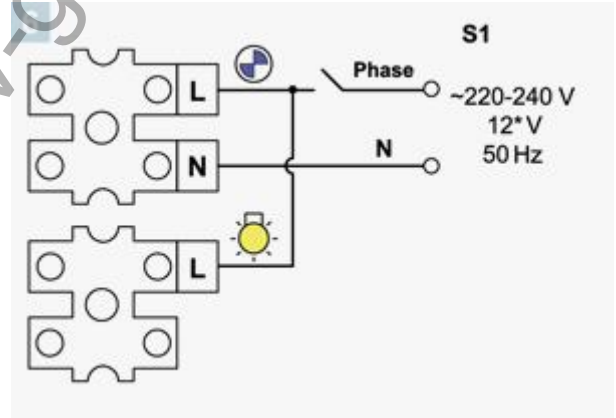

Wiring diagram for the fans with a light lamp and grounding. Parallel switching of the fan and the built-in lamp.

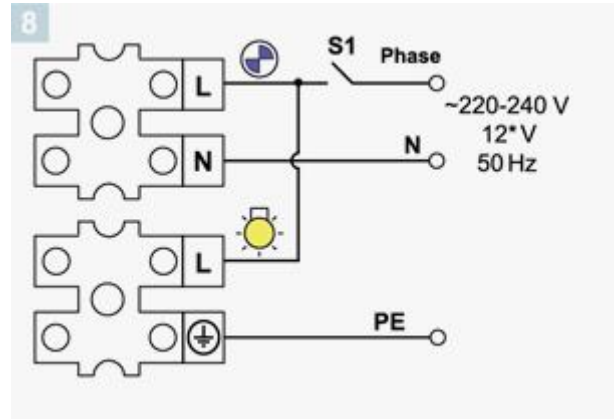

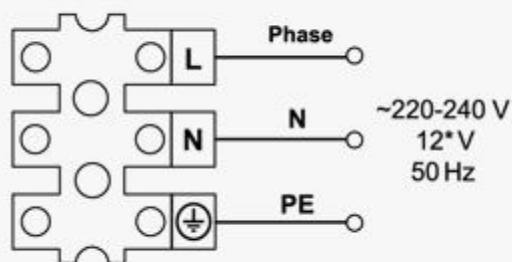


* - only for fans designed for 12 V rated voltage (specified on the fan casing and packing).

S, S1, S2 - external switches.

Operating logic of the fans with optional equipment

- The fan equipped with a timer is activated by the control voltage supplied to LT input. After the control voltage is disconnected the fan continues operating within the time period within 2 to 30 minutes according to the timer settings. The turn-off delay time is adjusted by turning the respective potentiometer T control knob clockwise to increase and counter-clockwise to reduce it.
- The fan equipped with a timer and humidity sensor is activated by the control voltage supplied to LT input or in case of exceeding the preset humidity threshold value adjustable from ~60% to ~90%. After the control voltage is disconnected or as the humidity level H drops below the set threshold the fan continues operating within the time period within 2 to 30 minutes according to the timer settings. The turn-off delay time and the threshold humidity level are adjusted by turning the control knob of the respective potentiometer T for timer and H for humidity sensor clockwise to increase and counter-clockwise to reduce the set value. To set the maximum humidity level (90%) set the potentiometer control knob for H max position.
- The fan equipped with a timer and motion sensor is activated in case of the moving detection at the distance from 1 m to 4 m with 100° detection angle. After motion is off the fan continues operating within the time period within 2 to 30 minutes according to the timer settings. The turn-off delay time is adjusted by turning the respective potentiometer T control knob clockwise to increase and counter-clockwise to reduce it.
- Wiring diagram for connection of the light lamp to the fan timer operated by the common switch is shown on diagram 4. Upon the light lamp disconnection the fan continues operating according to the timer setting within the set time period.

Sizes

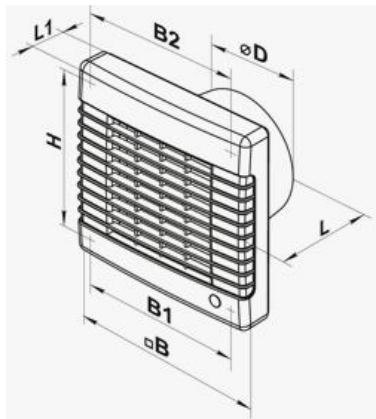

□D	B	B1	B2	H	L	L1
100	165	150	150	150	92	32

Ташев-Галвинг ООД
www.tashev-galving.com

E-mail
Please, feel free to contact us.
support@vents.ua

Phone
Customer service.
+380 44 406 36 25

Ukraine, 08150, Boyarka,
st 40 years of October, 36

Ташев-Галвинг ООД
www.tashev-galving.com